

Ahmedabad Municipal Corporation



S.W.M.
Health Department

Sr. No. 41



SANITARY CONVENIENCE CERTIFICATE

A Certificate for Sanitary Convenience is issued to the Manager / Secretary / Organiser of the Talkies / Theatre namely S.H. KHARAWALA.....
A.G. & L.D. PRIMARY SCHOOL..... Situated
at Opp. Deedar Sahab Flats, CWU University Road, Navrangpura,
for the period of 24..... months / Days i. e. from 01/01/2022 200
to 31/12/2023.. 200

Date : 14/3/23

Bomsh 14-3-23
Dy./Add. Medical officer of Health
Municipal Corporation Ahmedabad.

A.D.(S.W.M.-W.Z.)

"Issued Subject to NOC from other Concerned departments".

Copy to :-

1. The Manager / Secretary
2. The Commissioner of Police Ahmedabad.

2100/- u.o. 1339/51
14/3/23



AHMEDABAD MUNICIPAL CORPORATION
MAHANAGAR SEVA SADAN
CENTRAL LABORATORY
(An ISO 9001: 2015 Accredited Laboratory)



Lic No QAC/R91/4650

Dudheshwar Water Works Compound, Dudheshwar, Ahmedabad-380 004, Gujarat, India
E-mail: centrallab@ahmedabadcity.gov.in, Phone No-(079) 25631105, 25630438.

28 February, 2023.

To,
The Principal
S.H. Kharawala, A.G. & L.D. Primary School,
Opp. Dada Saheb Flat, University Road,
Navrangpura, Ahmedabad – 380009.

Dear Sir,

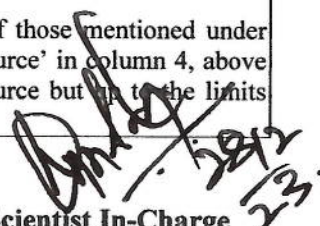
We have analyzed your water samples collected on Dt. 21-02-2023 for the following **Chemical and Bacteriological** parameters. The analysis report is as hereunder.

Sr. No.	Parameter	Requirement (Acceptable Limit)	Permissible Limit in the Absence of Alternate Source	After Filter	Bore
		As per IS-10500-2012			
A. Organoleptic and Physical Parameters					
1	Colour, Hazen units, Max	5	15	0.1	0.1
2	pH value	6.5-8.5	No relaxation	7.5	7.7
3	Turbidity, NTU, Max	1	5	0.16	0.26
4	Total dissolved solids, mg/l, Max	500	2000	318	986
B. General Parameters					
1	Total hardness (as CaCO ₃), mg/l, Max	200	600	50	300
2	Calcium (as Ca), mg/l, Max	75	200	12	68
3	Magnesium (as Mg), mg/l, Max	30	100	4.88	31.72
4	Chloride (as Cl), mg/l, Max	250	1000	80	240
5	Sulphate (as SO ₄) mg/l, Max	200	400	10.8	61.3
6	Total alkalinity as calcium carbonate, mg/l, Max	200	600	140	500
7	Free residual chlorine, mg/l, Min	0.2	1	Nil	Nil
C. Bacteriological Quality of Drinking Water					
1	Total Coliform bacteria, MPN/100 ml.	Shall not be detectable in any 100 ml sample	Shall not be detectable in any 100 ml sample	Not Detected	Not Detected
2	E. coli, MPN/100 ml.	Shall not be detectable in any 100 ml sample	Shall not be detectable in any 100 ml sample	Not Detected	Not Detected

Remarks:

1. The Central Laboratory, AMC, has collected the samples.
2. The result contained in this report relate only to the sample material tested.
3. The report is not being reproduce wholly or in part and cannot be used as evidence in the court of law and should not be used in any advertising media without our special permission in writing.

NOTE — It is recommended that the acceptable limit is to be implemented. Values in excess of those mentioned under 'acceptable' render the water not suitable, but still 'permissible limit in the absence of alternate source' in column 4, above which the sources will have to be rejected. May be tolerated in the absence of an alternative source but up to the limits indicated.


Scientist In-Charge
Central Laboratory