

# Ahmedabad Municipal Corporation



Sr. No. 89



*Swm*  
Health Department

## SANITARY CONVENIENCE CERTIFICATE

A Certificate for Sanitary Convenience is issued to the Manager / Secretary / Organiser of the Talkies / Theatre namely A.E.S. - A.C. SCHOOL (ENGLISH MEDIUM) (formerly known as S.H. Kharuwalla, A.C. & L.D. Primary School) situated at opp. Dada Saheb flat, University Road, Navrangpura, Ahmedabad. for the period of 12 months / Days i. e. from 01/01/25 200 to 31/12/25 200

Date : 05/05/25

*D. J. Joshi*  
Dy./Add. Medical Officer of Health  
Municipal Corporation, Ahmedabad.  
Dy. Director  
(S.W.M. West Zone)

"Issued Subject to NOC from other Concemed departments".

Copy to :-

1. The Manager / Secretary
2. The Commissioner of Police Ahmedabad.

*Rs 1000/- 4.5. 1196/53*  
*05/05/25*



AHMEDABAD MUNICIPAL CORPORATION  
MAHANAGAR SEVA SADAN  
**CENTRAL LABORATORY**  
(An ISO 9001: 2015 Accredited Laboratory)



Lic No QAC/R91/4650

Dudheshwar Water Works Compound, Dudheshwar, Ahmedabad-380 004, Gujarat, India  
E-mail: [centrallab@ahmedabadcity.gov.in](mailto:centrallab@ahmedabadcity.gov.in), Phone No-(079) 25631105, 25630438.

February 05, 2025.

To,  
The Principal,  
A.E.S. – A.G. School (English Medium)  
Opp. Dada Saheb Flat, University Road  
Navrangpura, Ahmedabad – 380009.

Dear Sir,

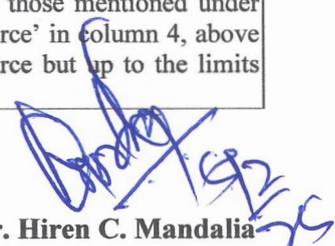
We have analyzed your water samples collected on Dt. 29-01-2025 for the following **Chemical and Bacteriological** parameters. The analysis report is as hereunder.

Sr. No.	Parameter	Requirement (Acceptable Limit)	Permissible Limit in the Absence of Alternate Source	Primary School	Pre School
		As per IS-10500-2012			
<b>A. Organoleptic and Physical Parameters</b>					
1	Colour, Hazen units, Max	5	15	0.1	0.1
2	pH value	6.5-8.5	No relaxation	8.2	6.7
3	Turbidity, NTU, Max	1	5	0.3	0.23
4	Total dissolved solids, mg/l, Max	500	2000	118	156
<b>B. General Parameters</b>					
1	Total hardness (as CaCO <sub>3</sub> ), mg/l, Max	200	600	20	20
2	Calcium (as Ca), mg/l, Max	75	200	4	4
3	Magnesium (as Mg), mg/l, Max	30	100	2.44	2.44
4	Chloride (as Cl), mg/l, Max	250	1000	35	40
5	Sulphate (as SO <sub>4</sub> ) mg/l, Max	200	400	8.2	8.6
6	Total alkalinity (as CaCO <sub>3</sub> ), mg/l, Max	200	600	30	60
7	Free residual chlorine, mg/l, Min	0.2	1.0	Nil	Nil
<b>C. Bacteriological Quality of Drinking Water</b>					
1	Total Coliform bacteria, MPN/100 ml.	Shall not be detectable in any 100 ml sample	Shall not be detectable in any 100 ml sample	Not Detected	Not Detected
2	E. coli, MPN/100 ml.	Shall not be detectable in any 100 ml sample	Shall not be detectable in any 100 ml sample	Not Detected	Not Detected

**Remarks:**

- The Central Laboratory, AMC, has collected the samples.
- The result contained in this report relate only to the sample material tested.
- The report is not being reproduce wholly or in part and cannot be used as evidence in the court of law and should not be used in any advertising media without our special permission in writing.

NOTE — It is recommended that the acceptable limit is to be implemented. Values in excess of those mentioned under 'acceptable' render the water not suitable, but still 'permissible limit in the absence of alternate source' in column 4, above which the sources will have to be rejected. May be tolerated in the absence of an alternative source but up to the limits indicated.

  
Dr. Hiren C. Mandalia  
Scientist In-Charge